


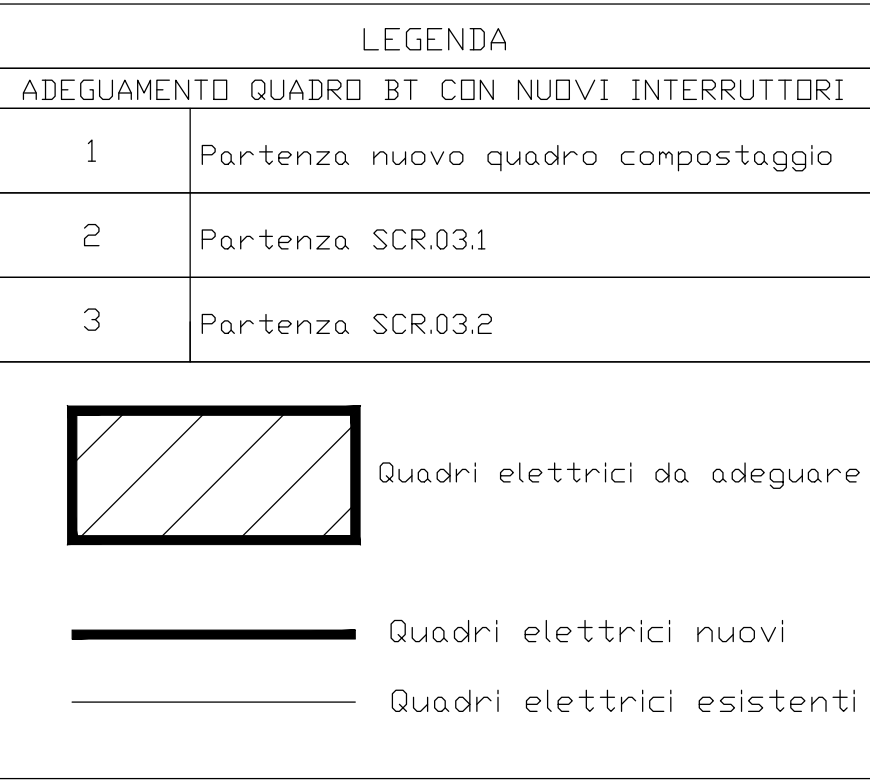

QUADRO ESISTENTE DI BASSA TENSIONE							
Utenza	Sigla cavo	Distribuzione	Designazione	Lungh. [m]	Sez. Fase	Sez. Neutro	Sez. PE
Q.SCR.03.1	-WC0.1.3	3L+N+PE	FG16R16	30	1x185	1x95	1x95
Q.SCR.03.2	-WC0.1.4	3L+N+PE	FG16R16	30	1x185	1x95	1x95
Q.COMP.	-WC0.1.5	3L+N+PE	FG16R16	230	4x240	2x240	2x240

Utenza	Sigla cavo	Distribuzione	Designazione	Lungh. [m]	Sez. Fase	Sez. Neutro	Sez. PE
Q.TRIT	-WC3.1.6	3L+N+PE	FG16R16	110	1x120	1x70	1x70
Q.MISC.	-WC3.1.7	3L+N+PE	FG16R16	75	1x70	1x35	1x35
Q.FM.01	-WC3.1.8	3L+N+PE	FG16R16	125	1x35	1x16	1x16
Q.FM.02	-WC3.1.9	3L+N+PE	FG16R16	70	1x35	1x16	1x16
Q.AUT.01	-WC3.1.10	3L+N+PE	FG16R16	55	1x6	1x6	1x6
Q.BIO.01	-WC3.1.11	3L+N+PE	FG16R16	95	1x35	1x16	1x16
Q.BIO.02	-WC3.1.12	3L+N+PE	FG16R16	100	1x35	1x16	1x16
Q.BIO.03	-WC3.1.13	3L+N+PE	FG16R16	105	1x35	1x16	1x16
Q.BIO.04	-WC3.1.14	3L+N+PE	FG16R16	110	1x35	1x16	1x16
Q.TLC	-WC3.1.15	3L+N+PE	FG16OR16	10	1x6	1x6	1x6

E' vietata ai sensi di legge la divulgazione e la riproduzione del presente disegno senza la preventiva autorizzazione